

Operations Manual



Automated Fuel Maintenance System



APPROVED

FTI-2.8

FUEL TECHNOLOGIES INTERNATIONAL

Controller Programming And Operating Instructions

Contents

Introduction / Overview.....	Page 3
Controller Set-Up with the Touch Screen.....	Page 4
Default Start-Up Screen.....	Page 5
Menu Screen.....	Page 6
Company Information Screen.....	Page 7
Clock Adjust Screen.....	Page 8
Select the Day of the Week to Run & set the Start and Stop times.....	Page 9
Set-Up Delays for Alarms to trip.....	Page 10
Main Operations Screen.....	Page 11
How to Cancel System Alarms.....	Page 11
Alarm Message Descriptions.....	Page 12
How to Run In Manual and Auto Modes.....	Page 13

Introduction

This manual assumes the system is installed and ready for operation. If the system has not yet been installed, please refer to the Installation manual for instructions.

Overview

FTI Fuel Monitoring and Maintenance Systems are designed for ease of use. Once installed, the system will operate automatically to the schedule you program into it. The schedule should be determined by your specific needs, fuel and tank conditions, weather, etc. and can be changed at any time. ***It is recommended to filter approximately 20% of the tank per week.*** (If you are not sure what your optimum schedule might be, your FTI representative can assist you).


Your FTI system will maintain all data input by you, such as the time, start and stop times. ***This will last for up to 80 hours without power. After that, the data will have to be re-entered.***

If the system is in auto mode and stopped for any reason, it will resume the schedule when the interruption is complete. You can also switch to manual mode at any time. The system will resume with the pre-programmed schedule when put back into auto mode.

Depending on the condition of the fuel to be maintained, you may initially be changing the filter more frequently than expected. Your FTI system will stop operation and signal you when the filter is full. The system will resume the program when restarted after the filter is replaced. As the fuel quality progressively increases, you will notice a dramatic drop in filter usage.

In cases of ***Serious Contamination***, it is recommended that you have your ***Fuel Polished*** prior to initial use of your FTI system. Since the FTI system is proactive, continued use prevents the fuel from deteriorating again and maintains a healthier environment to protect both the fuel and the tank.

Controller Set-Up with the Touch Screen

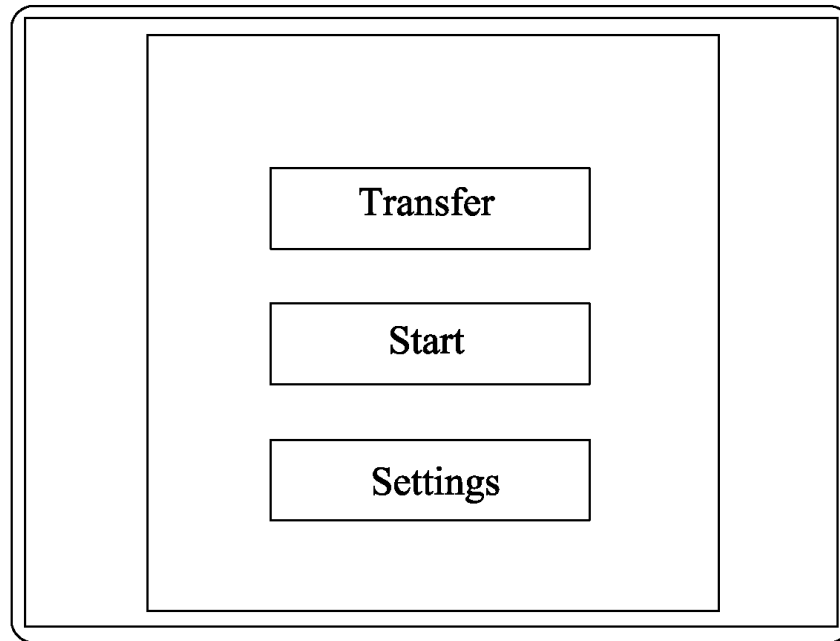


Once the Fuel Management System is installed, you're ready to program the controller.

When you apply power to the system, the display will go through a boot up sequence, and the screen above will appear for a few seconds. **DO NOT PUSH ANY BUTTONS ON THIS SCREEN UNLESS:**

- 1. *The Auto Start function is not working then push START.***
- 2. To prolong the touch screens life set the SCREEN SAVER to 2 hours.**
- 3. *Press the SETTINGS BUTTON then scroll down to the bottom to SCREEN SAVER.***

Wait until this screen above changes to the default **Main Operations Screen** (next page).

Default Start-Up Screen

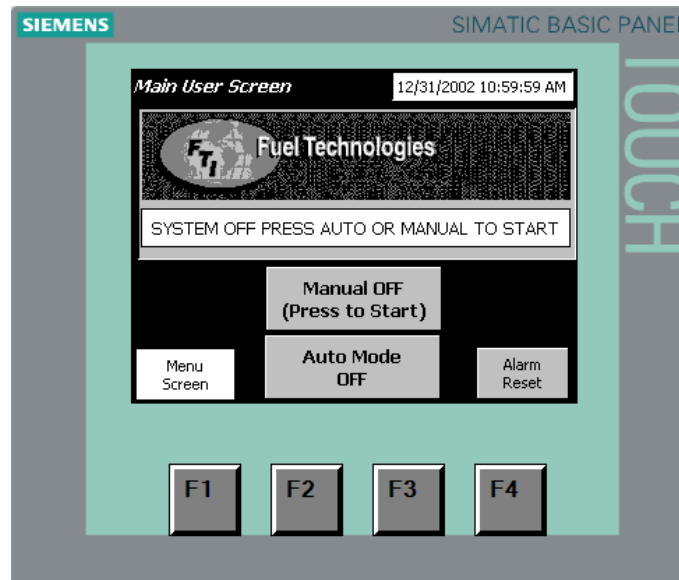


The screen above is the Main Operations Screen.

From this screen You Can:

1. Go to the Menu Screen.
2. Switch from Auto Mode to Manual Mode.
3. Reset all alarms. (This button only shows when system is in alarm mode)
4. Turn system On & Off in Manual Mode.
5. Put system in Auto Mode.
6. Buttons F1, F2, F3 and F4 are inactive at this time.

To Set-Up the Controller Press the Menu Screen Button.

Menu Screen

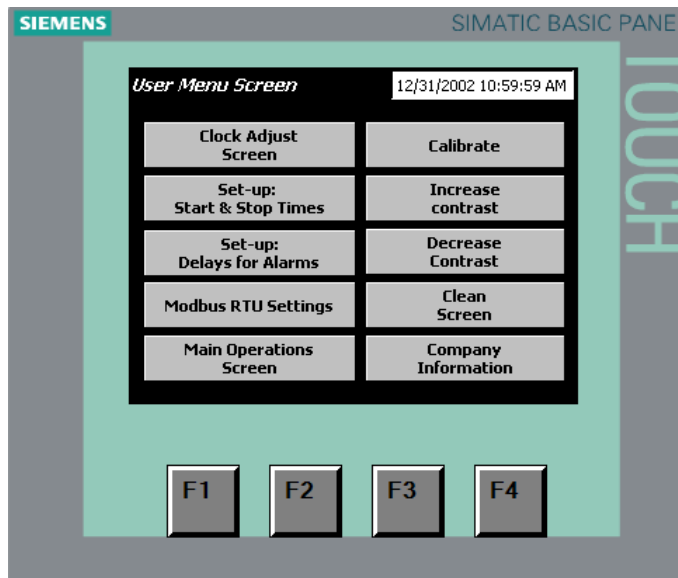

The screen above will appear.

This is the screen to access all system functions.

From the left hand column you can:

1. Adjust the clock.
2. Set-up start and stop times.
3. Set-up delays for alarms to trip.
4. Set-up Modbus RTU Settings.
5. Access the Main Operations Screen, from where you can manually turn system on and off.

From the right hand column you can:

1. Re-calibrate the screen.
2. Increase the contrast on the screen.
3. Decrease the contrast on the screen
4. Clean the screen.
5. Look up Fuel Technologies company information.

From the Menu Screen Press the Company Information Button

Company Information Screen




The screen above is the ***Company Information Screen***.

This is where you can look up Fuel Technologies International

1. Mailing Address
2. Website information
3. Switch to the Main Screen.
4. Switch to the Menu Screen.

Next Press the Menu Screen Button, Then the Clock Adjust Button.

Clock Adjust Screen

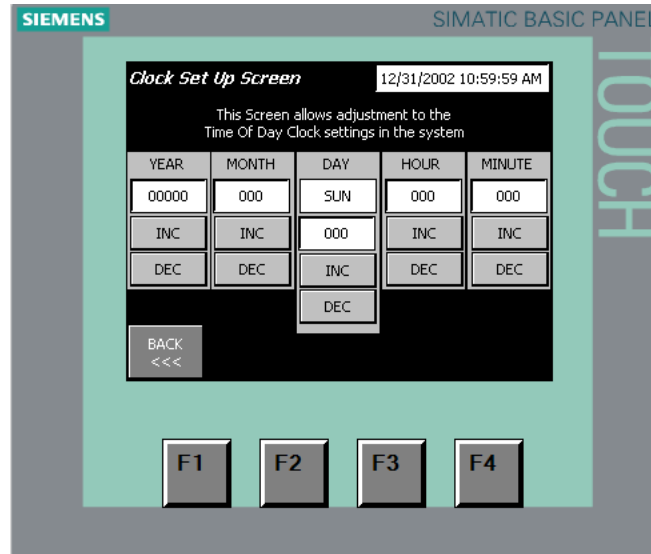


The screen above will appear.

1. Start on the left column under **Year**; press the **(INC) Increase** or **(DEC) Decrease Button** until the correct year appears.
2. Do the same for the **Month, Day, Hour** and the **Minute**.

When Completed Press the BACK Button,
Then press the Set-up: Start & Stop Times Button


Select Day of the Week to Run & the Start and Stop Times.

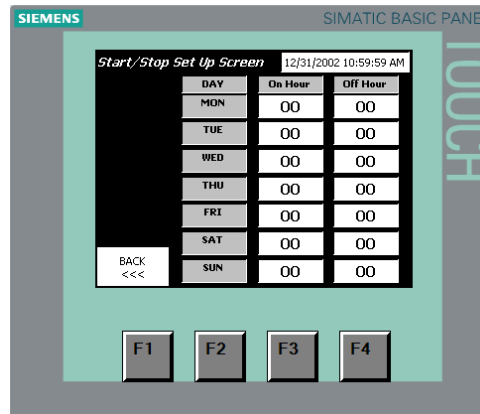

1. Locate the row for the day of the week you want the system to run, then touch the "00" white box.
2. The key board screen below will appear.
3. Press the number/numbers for the **On Hour** you want the system to start. The clock setting numbers are military style (1-23 Hours). E: 9=9AM, 13=1PM
4. When you push a button on the key board, the number will show in the upper right hand text box.
5. To enter your selection push the **large arrow button** located at the bottom right of key board.
6. If you select the wrong number use the BSP button to back space (erases numbers selected)
7. Repeat the process for the **Off Hour** time.


How to estimate the Run Time Hours

1. The recommended amount of fuel to clean is 20-25% of the tank per week.
2. Example: 25% of a 2,000 Gallon Tank = 500 gallons.
3. Then take the pump size: 2.8 GPM (gallons per minute) x 60 minutes = 168 gallons per hour.
4. Then divide 168 (gallons per hour) into 500 gallons (25% of tank) = 2.98 hours per week.
5. Round up to 3 hours per week.

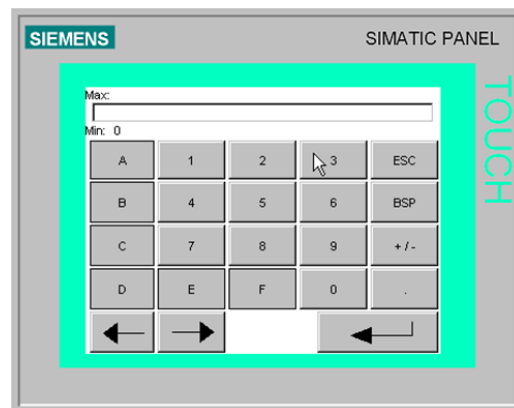

Press the BACK Button. Then press the Set-up Delays for Alarms

Set-up Delays for Alarms to Trip

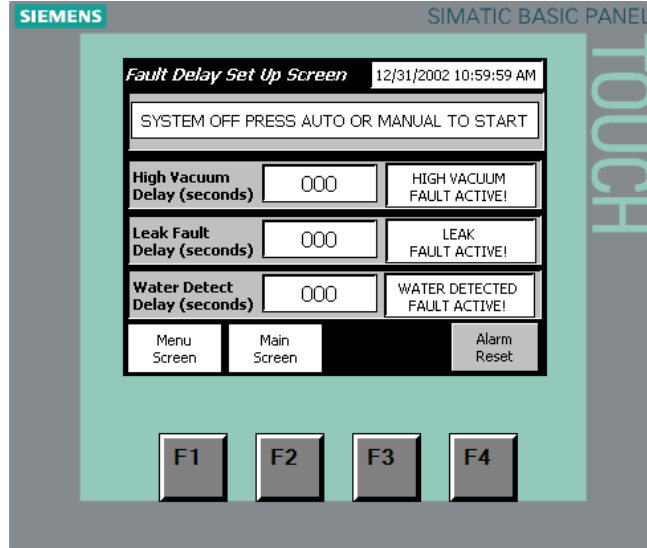

The screen above will appear.

If you have special circumstances that require you to **delay the alarms from going off** then continue with this step, if not skip forward to the bottom of this page.


Here you can delay:

1. **High Vacuum Alarm:** This signals the operator that the filter is plugged or there is something plugged in the supply fuel line.
2. **Leak Fault Alarm:** This signals the operator that there is a leak in the cabinet.
3. **Water Detect Alarm:** This signals the operator that the collection bowl on the water separator is full.
4. To adjust the settings, touch or press the number in the box as described for the key board on page 9.

When Completed Press the Main Screen Button

Main Operations Screen

1. You can Access the **Menu Screen**
2. You can select **Manual Mode** to run system or **Auto Mode** to run system per the **Start** and **Stop** times.
3. In **Manual Mode** the system will stand idle. (Put in Manual Mode for servicing the filters)
4. You can turn the system on and off in **Manual Mode**. Press the **Manual Off Button** to turn on. Press the same button now labeled **Manual On** to turn off.
5. In **Auto Mode** the system will stand idle until the **Start Time** you entered begins. To stop **Auto Mode** while the system is running, press the Auto Mode Button and the system will go into standby.

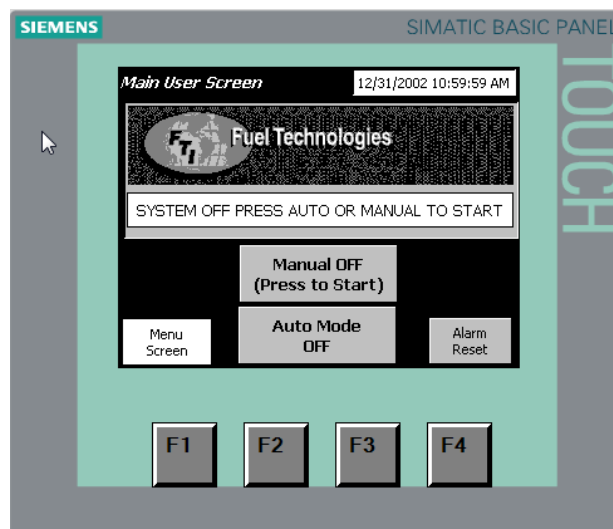

How to Cancel System Alarms

First read the Alarm Description on the screen, and then push the **Alarm Reset Button** to stop the alarm and reset the system. (Alarm description will appear in the text box above the **Manual Off** Button)

There is also a Alarm Reset Button on the Set-Up Delays for Alarms screen.

(Both Reset buttons show when system is in alarm mode, otherwise they are **hidden**)

Note: The system will switch to **Manual Mode** off for safety reasons when alarm status is reset. Be sure the system is in **Manual Mode**, and is not running before attempting any maintenance operations. This is to avoid leakage or other possible hazards. Once maintenance has been performed (such as changing the filter), turn system on manually to check for leaks. Then reset to **Manual Mode** or **Auto Mode** and resume the scheduled program.

You Have Now Completed the Controller Set-Up

ALARM MESSAGE DESCRIPTIONS

If a problem is detected in the following areas, the system will stop filtering, display the appropriate alarm message on the screen, and will sound an audible alarm to alert the operator. The alarm consists of a sequence of steady high-pitched beeping sounds that continue until the operator pushes the reset button and corrects the problem.

Touch-Screen Alarm Messages	Alarm Locations & Action required to fix the problem
<p>HIGH VACUUM FAULT</p> <p>Change Filter & Reset</p>	<p>Vacuum Switch Gauge</p> <p>Action: Check 2 Micron Filter, or the supply line for blockage.</p>
<p>WATER DETECTED</p> <p>Drain and Reset</p>	<p>Water Level Sensor</p> <p>Action: Drain water from the water separator.</p>
<p>LEAK DETECTED</p> <p>Repair Leak & Reset</p>	<p>Leak Sensor: Leakage has occurred within the cabinet area.</p> <p>Action: Locate and repair leak in the cabinet.</p>
<p>MOTOR OVERLOAD</p> <p>Reset on touch screen. Reset Motor Overload.</p>	<p>This will occur if pump/motor is over heated or over-loaded.</p> <p>Action: Find cause and repair.</p> <ol style="list-style-type: none"> 1. Press the touch screen RESET button and then; 2. Press the RESET button on the Motor Overload inside of the control panel.

RUNNING MANUAL MODE

From the Main Operations Screen, press the **Manual Off** button, this will turn the system **ON** and it will begin to pump fuel through the system. Pressing the same button now labeled **Manual On** button will turn the system **OFF**.

RUNNING AUTO MODE

To switch to Auto Mode, press the **Auto Mode Off** button.

The controller will execute the schedule programmed earlier by you.

NOTE: IF POWER IS INTERRUPTED FOR ANY REASON THE PREVIOUS MODE SETTING (AUTO OR MANUAL) WILL COME BACK ON. IF IN AUTO MODE, AND THE POWER GOES OFF FOR ANY LENGTH OF TIME DURING THE SCHEDULED RUN TIME, THE SYSTEM WILL RUN THE PROGRAMMED SCHEDULE WHEN POWER IS RESUMED.

INTERRUPTING AUTO MODE

To stop the system while running in **Auto Mode**, press the **Auto Active** button. (This should be done before performing maintenance tasks, such as changing filters, draining separators, etc.) To resume operation, press the **Auto Mode Off** button. The system will now resume with the pre-programmed schedule.